































Features

- · Ultra slim design with 70mm(4SU) width
- Universal input 85~264VAC(277VAC operational)
- No load power consumption<0.3W
- Isolation class ${
 m II}$
- · Pass LPS (Limited power source) for Blank type
- DC output voltage adjustable
- · Protections : Short circuit / Overload / Over voltage
- Cooling by free air convection (working temperature:-30~+70°C)
- DIN rail TS-35/7.5 or 15 mountable
- Over voltage category III
- · LED indicator for power on
- 3 years warranty


Applications

- · Household control system
- Building automation
- Industrial control system
- Factory automation
- · Electro-mechanical apparatus

Description

HDR-100 is one economical ultra slim 100W DIN rail power supply series, adapt to be installed on TS-35/7.5 or TS-35/15 mounting rails. The body is designed 70mm(4SU) in width, which allows space saving inside the cabinets. The entire series adopts the full range AC input from 85VAC to 264VAC(277VAC operational) and conforms to BS EN/EN61000-3-2, the norm the European Union regulates for harmonic current. HDR-100 is designed with plastic housing that it can effectively prevent user from electric hazards. With working efficiency up to 90%, the entire series can operate at the ambient temperature between -30°C and 70°C under air convection. The complete protection functions and relevant certificates for home automations and industrial control apparatus (IEC62368-1, UL508, UL62368-1, BS EN/EN61558-2-16) make HDR-100 a very competitive power supply solution for household and industrial applications.

Model Encoding

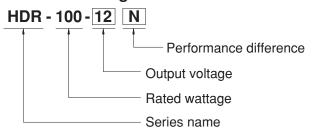

Туре	Description	Note
Blank	92W max, Pass LPS with a narrower output adjustable range	In stock
N	100W max, Non-LPS with a wider output adjustable range	In stock



SPECIFICATION

			HDR-100-12	HDR-100-12N	HDR-100-15	HDR-100-15N	HDR-100-24	HDR-100-24N	HDR-100-48	HDR-100-48	
	DC VOLTAGE		12V		15V		24V		48V		
ОИТРИТ	RATED CURRENT		7.1A	7.5A	6.13A	6.5A	3.83A	4.2A	1.92A	2.1A	
	CURRENT RANG	E	0 ~ 7.1A	0 ~ 7.5A	0 ~ 6.13A	0 ~ 6.5A	0 ~ 3.83A	0 ~ 4.2A	0 ~1.92A	0 ~ 2.1A	
	RATED POWER		85.2W	90W	92W	97.5W	92W	100.8W	92.2W	100.8W	
	RIPPLE & NOISE (max.) Note.2		120mVp-p		120mVp-p		150mVp-p		240mVp-p		
	VOLTAGE ADJ. Pass LPS		12 ~ 13V		15 ~ 17V		24 ~ 25.5V		48 ~ 48.7V		
	RANGE	Non LPS	12~ 13.8V		13.5 ~ 18V		21.6 ~ 29V		43.2 ~ 55.2V		
	VOLTAGE TOLER	RANCE Note.3	±2.0%		±1.0%		±1.0%		±1.0%		
	LINE REGULATION		±1.0%		±1.0%		±1.0%		±1.0%		
	LOAD REGULATION		±1.0%		±1.0%		±1.0%		±1.0%		
	SETUP, RISE TIME		500ms, 60ms/230VAC 500ms, 60ms/115VAC at full load								
	HOLD UP TIME (Тур.)	30ms/230VAC 12ms/115VA								
	VOLTAGE RANG	iΕ	85 ~ 264VAC (277VAC operational) 120 ~ 370VDC (390VDC operational)								
	FREQUENCY RA	NGE	47 ~ 63Hz								
NPUT	EFFICIENCY (Typ	p.)	88%								
	AC CURRENT (T	yp.)	3A/115VAC	1.6A/230VAC							
	INRUSH CURRE		COLD START 35A/115VAC 70A/230VAC								
PROTECTION	OVERLOAD		HDR-100 : 102 ~ 110% rated output power ; HDR-100-xxN : 105 ~ 150% rated output power								
			Hiccup mode when output voltage <50%, recovers automatically after fault condition is removed Constant current limiting within 50% ~100% rated output voltage, recovers automatically after fault condition is removed								
	OVER VOLTAGE		14.2 ~ 16.2V								
			Protection type	: Shut down o/p v	oltage, re-power	on to recover			ı		
ENVIRONMENT	WORKING TEMP).	-30 ~ +70°C (Refer to "Derating Curve")								
	WORKING HUMI		20 ~ 90% RH non-condensing								
	STORAGE TEMP		-40 ~ +85°C, 10 ~ 95% RH non-condensing								
	TEMP. COEFFIC		$\pm 0.03\%^{\circ}$ C (0 $\sim 50^{\circ}$ C) RH non-condensing								
	VIBRATION		10 ~ 500Hz, 2G 10min./1cycle, period for 60min. each along X, Y, Z axes; Mounting: Compliance to IEC60068-2-6								
	OPERATING A	LTITUDE	2000 meters								
	OVER VOLTAGE		III ; According to EN61558, EN50178, EN60664-1, EN62477-1 ; altitude up to 2000 meters								
	SAFETY STAND	ARDS	UL62368-1, UL508, TUV BS EN/EN61558-2-16, BS EN/EN61558-1, IEC62368-1, EAC TP TC 004, BSMI CNS14336-1 approved; Design refer to TUV BS EN/EN62368-1								
	WITHSTAND VO		I/P-O/P:4KVAC								
	WITHSTAND VO	LTAGE	I/P-O/P:4KVAC								
	ISOLATION RES			Ohms / 500VDC / 2	25°C/70% RH						
				Ohms / 500VDC / 2	25°C / 70% RH Standard			Test Level / Not	te		
			I/P-O/P:100M C	Ohms / 500VDC / 2	Standard	5032(CISPR32),	CNS13438	Test Level / Not	te		
		ISTANCE	I/P-O/P:100M C	Dhms / 500VDC / 2	Standard BS EN/EN5	5032(CISPR32), 5032(CISPR32),			de		
	ISOLATION RES	ISTANCE	I/P-O/P:100M C Parameter Conducted		Standard BS EN/EN5	5032(CISPR32),		Class B	ie		
SAFETY &	ISOLATION RES	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr	ent (Note 5)	Standard BS EN/EN5 BS EN/EN5	5032(CISPR32), 1000-3-2		Class B Class B	te		
EMC	ISOLATION RES	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker	ent (Note 5)	BS EN/EN5 BS EN/EN5 BS EN/EN6 BS EN/EN6	5032(CISPR32), 1000-3-2 1000-3-3		Class B Class B Class A	de		
EMC	ISOLATION RES	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker	ent (Note 5)	BS EN/EN5 BS EN/EN5 BS EN/EN6 BS EN/EN6	5032(CISPR32), 1000-3-2 1000-3-3		Class B Class B Class A			
EMC	ISOLATION RES	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker BS EN/EN5502	ent (Note 5)	Standard BS EN/EN5 BS EN/EN6 BS EN/EN6 BS EN/EN6 00-6-2, BS EN/E Standard	5032(CISPR32), 1000-3-2 1000-3-3 EN61204-3		Class B Class B Class A Test Level /Not	te	contact. criteria	
EMC	ISOLATION RES	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker BS EN/EN5502 Parameter ESD	ent (Note 5) 4, BS EN/EN610	Standard BS EN/EN5 BS EN/EN6 BS EN/EN6 BS EN/EN6 BS EN/EN6 O0-6-2, BS EN/E Standard BS EN/EN6	5032(CISPR32), 1000-3-2 1000-3-3 EN61204-3		Class B Class A Test Level /Not Level 3, 8KV ai	te r; Level 2, 4KV c	contact, criteria	
EMC	EMC EMISSION	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker BS EN/EN5502 Parameter ESD Radiated Susce	ent (Note 5) 4, BS EN/EN610	Standard BS EN/EN5 BS EN/EN6 BS EN/EN6 BS EN/EN6 O0-6-2, BS EN/E Standard BS EN/EN6 BS EN/EN6	5032(CISPR32), 1000-3-2 1000-3-3 EN61204-3 1000-4-2 1000-4-3		Class B Class A Test Level /Not Level 3, 8KV ai Level 3, criteria	te r; Level 2, 4KV c	contact, criteria	
EMC	ISOLATION RES	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker BS EN/EN5502 Parameter ESD Radiated Susce EFT/Burest	ent (Note 5) 4, BS EN/EN610	Standard BS EN/EN5 BS EN/EN6 BS EN/EN6 00-6-2, BS EN/E Standard BS EN/EN6 BS EN/EN6 BS EN/EN6	5032(CISPR32), 1000-3-2 1000-3-3 EN61204-3 1000-4-2 1000-4-3 1000-4-4		Class B Class B Class A Test Level /Not Level 3, 8KV ai Level 3, criteria	te r; Level 2, 4KV c	contact, criteria	
EMC	EMC EMISSION	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker BS EN/EN5502 Parameter ESD Radiated Susce EFT/Burest Surge	ent (Note 5) 4, BS EN/EN610	Standard BS EN/EN5 BS EN/EN6 BS EN/EN6 00-6-2, BS EN/E Standard BS EN/EN6 BS EN/EN6 BS EN/EN6 BS EN/EN6 BS EN/EN6	5032(CISPR32), 1000-3-2 11000-3-3 EN61204-3 1000-4-2 1000-4-3 1000-4-4 11000-4-5		Class B Class B Class A Test Level /Not Level 3, 8KV ai Level 3, criteria Level 4,2KV/L-	te r; Level 2, 4KV c a A a A N, criteria A	contact, criteria	
SAFETY & EMC Note 5)	EMC EMISSION	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker BS EN/EN5502 Parameter ESD Radiated Susce EFT/Burest Surge Conducted	ent (Note 5) 4, BS EN/EN610	Standard BS EN/EN5 BS EN/EN6 BS EN/EN6 00-6-2, BS EN/E Standard BS EN/EN6 BS EN/EN6 BS EN/EN6 BS EN/EN6 BS EN/EN6 BS EN/EN6	5032(CISPR32), 1000-3-2 11000-3-3 EN61204-3 1000-4-2 1000-4-3 1000-4-4 11000-4-5 1000-4-6		Class B Class A Test Level /Not Level 3, 8KV ai Level 3, criteria Level 4,2KV/L-l Level 3, criteria	te r; Level 2, 4KV c a A a A N, criteria A a A	contact, criteria	
EMC	EMC EMISSION	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker BS EN/EN5502 Parameter ESD Radiated Susce EFT/Burest Surge Conducted Magnetic Field	ent (Note 5) 4, BS EN/EN610	Standard BS EN/EN5 BS EN/EN6 BS EN/EN6 00-6-2, BS EN/E Standard BS EN/EN6 BS EN/EN6 BS EN/EN6 BS EN/EN6 BS EN/EN6	5032(CISPR32), 1000-3-2 1000-3-3 EN61204-3 1000-4-2 1000-4-3 1000-4-4 11000-4-5 1000-4-8		Class B Class B Class A Test Level /Not Level 3, 8KV ai Level 3, criteria Level 4, 2KV/L- Level 3, criteria Level 4, criteria Level 4, criteria	te r; Level 2, 4KV c a A a A N, criteria A a A 5 periods, 30% d	ip 25 periods,	
MC	EMC EMISSION	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker BS EN/EN5502 Parameter ESD Radiated Susce EFT/Burest Surge Conducted Magnetic Field Voltage Dips and	ent (Note 5) 4, BS EN/EN610 eptibility	Standard BS EN/EN5 BS EN/EN6 BS EN/EN6 O0-6-2, BS EN/E Standard BS EN/EN6 BS EN/EN6	5032(CISPR32), 1000-3-2 1000-3-3 EN61204-3 1000-4-2 1000-4-3 1000-4-4 11000-4-5 1000-4-8		Class B Class B Class A Test Level /Not Level 3, 8KV ai Level 3, criteria Level 4, 2KV/L- Level 3, criteria Level 4, criteria Level 4, criteria	te r; Level 2, 4KV c a A a A N, criteria A a A	ip 25 periods,	
EMC Note 5)	EMC EMISSION EMC IMMUNITY	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker BS EN/EN5502 Parameter ESD Radiated Susce EFT/Burest Surge Conducted Magnetic Field Voltage Dips at 856.5K hrs min	ent (Note 5) 4, BS EN/EN610 eptibility and interruptions MIL-HDBK-21	Standard BS EN/EN5 BS EN/EN6 BS EN/EN6 O0-6-2, BS EN/E Standard BS EN/EN6 BS EN/EN6	5032(CISPR32), 1000-3-2 1000-3-3 EN61204-3 1000-4-2 1000-4-3 1000-4-4 11000-4-5 1000-4-8		Class B Class B Class A Test Level /Not Level 3, 8KV ai Level 3, criteria Level 4, 2KV/L- Level 3, criteria Level 4, criteria Level 4, criteria	te r; Level 2, 4KV c a A a A N, criteria A a A 5 periods, 30% d	ip 25 periods,	
MC	EMC EMISSION	ISTANCE	I/P-O/P:100M C Parameter Conducted Radiated Harmonic Curr Voltage Flicker BS EN/EN5502 Parameter ESD Radiated Susce EFT/Burest Surge Conducted Magnetic Field Voltage Dips at 856.5K hrs min 70*90*54.5mm	ent (Note 5) 4, BS EN/EN610 eptibility and interruptions MIL-HDBK-21	Standard BS EN/EN5 BS EN/EN6 BS EN/EN6 00-6-2, BS EN/E Standard BS EN/EN6 BS EN/EN6 BS EN/EN6 BS EN/EN6 BS EN/EN6 BS EN/EN6 TF (25°C)	5032(CISPR32), 1000-3-2 1000-3-3 EN61204-3 1000-4-2 1000-4-3 1000-4-4 11000-4-5 1000-4-8		Class B Class B Class A Test Level /Not Level 3, 8KV ai Level 3, criteria Level 4, 2KV/L- Level 3, criteria Level 4, criteria Level 4, criteria	te r; Level 2, 4KV c a A a A N, criteria A a A 5 periods, 30% d	ip 25 periods,	

NOTE

- 4. Harmonic current test at 90% load for HDR-100-xxN.


 5. The power supply is considered as an independent unit, but the final equipment still need to re-confirm that the whole system complies with the EMC directives. For guidance on how to perform these EMC tests, please refer to "EMI testing of component power supplies."

 (as available on http://www.meanwell.com)

 6. The ambient temperature derating of 3.5°C/1000m with fanless models and of 5°C/1000m with fan models for operating altitude higher than 2000m(6500ft).
- % Product Liability Disclaimer : For detailed information, please refer to https://www.meanwell.com/serviceDisclaimer.aspx





■ Block Diagram

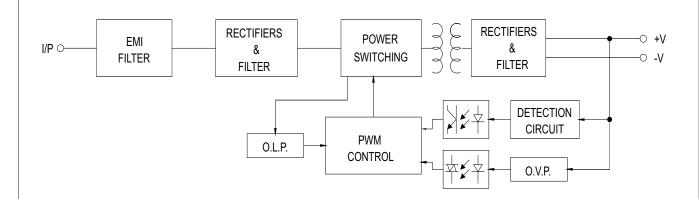

■ Derating Curve VS Ambient Temperature

■ Output Derating VS Input Voltage

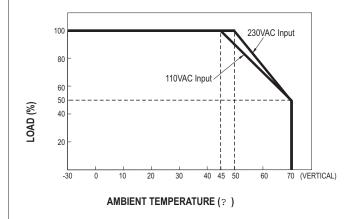


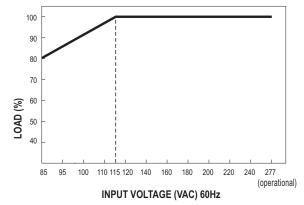




■ Mechanical Specification

(Unit: mm , tolerance ± 0.5mm)

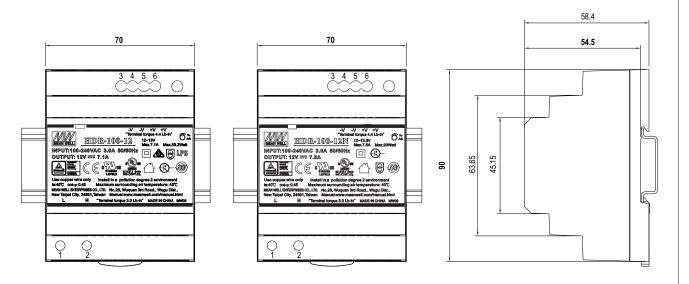



ADMISSIBLE DIN-RAIL:TS35/7.5 OR TS35/15

Terminal Pin No. Assignment

Pin No.	Assignment	Pin No.	Assignment
1	AC/L	3,4	-V
2	AC/N	5,6	+V

■ Installation Manual

Please refer to: http://www.meanwell.com/manual.html